

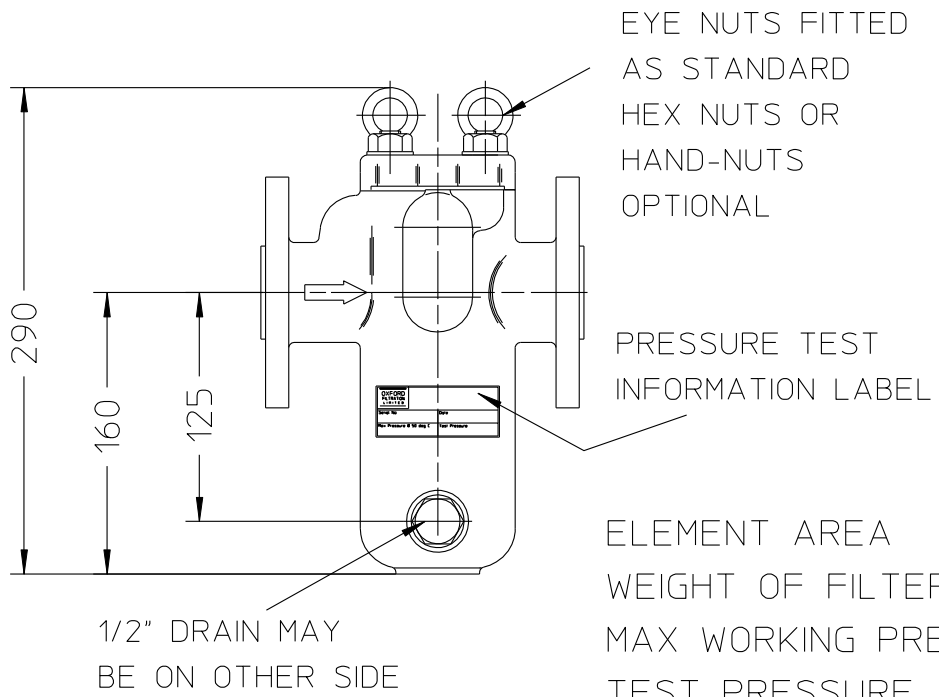


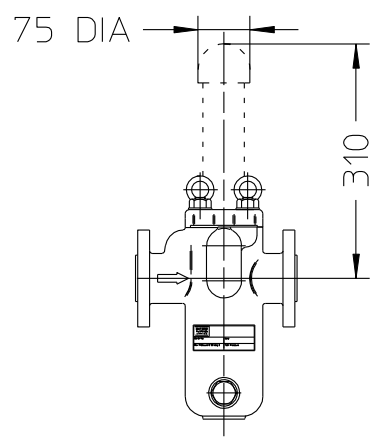

FLOW
→

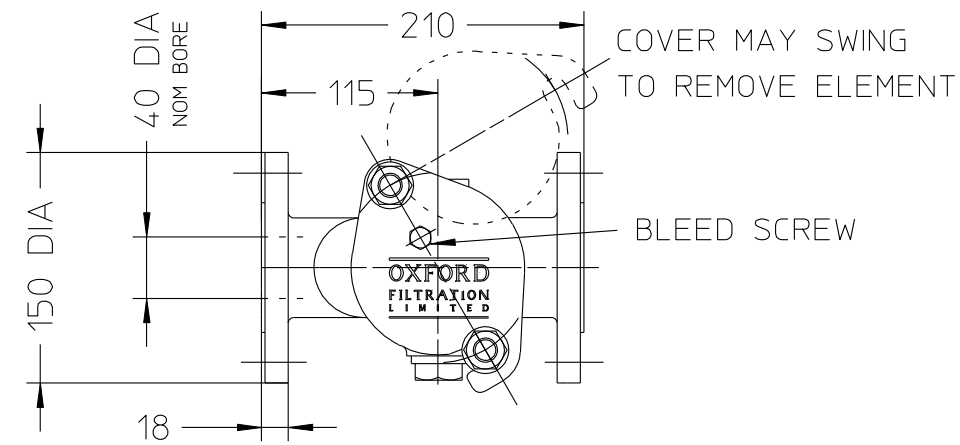

SPACE TO REMOVE ELEMENT

FLANGE TYPE REQUIREMENTS	
P.C.D OF HOLES	
DIA OF R/F	
R/F THICKNESS	
NO OF HOLES	
DIA OF HOLES	

- ELEMENT AREA - 300cm²
- WEIGHT OF FILTER - 14 kg
- MAX WORKING PRESSURE - 16 bar (CAST IRON)
- TEST PRESSURE - 24 bar

UNLESS SPECIFIED GENERAL TOLERANCE 0 DEC PLACE +/- 1 1 DEC PLACE +/- 0.4 2 DEC PLACE +/- 1.0 ANGULAR +/- 2 Deg	APPROVED	MATERIAL	DESCRIPTION		
	DRAWN A.S.N.	OXFORD FILTRATION LIMITED	GENERAL ARRANGEMENT DN40 Flg Single Filter		
MODIFICATION DRAIN WAS UNDER INLET	DATE 6/2/04	C 2003 This drawing and the design is the property of OXFORD FILTRATION LIMITED and may not be copied or used for anypurpose other than that for which it was supplied unless expressly stated in writing		DRG NO. 12072	ISS 2